



**Ventilating Filters**



**L1.0406 • L1.0506**

**L1.0706 • L1.0807**

- Connection up to 1<sup>5</sup>/<sub>8</sub>-12 UN-2A
- Nominal flow rate up to 225 gpm

## Description

### Application

Ventilation of tanks for hydraulic and lubrication systems, and gearboxes.

### General

The oil levels in the tanks of hydraulic systems are subject to continuous variation due to temperature changes and the operation of cylinders and pressure vessels.

In order to prevent over pressure in the tanks, an exchange of air with the external atmosphere is necessary. By the use of a ventilating filter, the outside air that is drawn in is filtered and the ingress of dust is therefore prevented.

### Special features

The ventilation openings are designed that dust on the surface of the tank is not drawn in, and that the ingress of spray and rainwater is largely prevented.

The use in marine applications presents no problem due to the use of synthetic materials and stainless steel.

### Design

Flow direction bi-directional (air IN/OUT). The star-shaped pleating of the filter material results in:

- large filter surfaces
- low pressure drop
- high dirt-holding capacities
- long service life

### Ordering options / versions

Integrated oil-level dipstick (for all types):

A dipstick can be integrated in the ventilating filter for checking the oil level. Therefore, a separate dipstick or an additional opening in the tank is not required.

Oil separator (L1.0807):

An effective protection against splashing oil in mobile operation.

Double check valves (L1.0506, L1.0807):

By the use of double check valves, the exchange of air between the tank and the environment can be considerably reduced, whereby the ingress of dust is minimized and the lifetime of the air filter element can be increased. With the double check valve, an over-pressure can be created in the tank in order to improve the suction conditions for the pumps.

A further advantage is the reduction of spray water entry and the loss of oil through the ventilating filter.

Vandalism proof types:

Ventilating filters in patented vandalism proof version, please see catalog sheet 50.20.

Filling and ventilating filters in standard or patented vandalism proof version, see catalog sheet 50.30.

### Maintenance

Ventilating filters should be changed at least every 1,000 operating hours, or at minimum once a year.

## Characteristics

### Nominal flow rate

Up to 225 gpm (see Selction Chart, column 2)

The nominal flow rates indicated by ARGO-HYTOS are based on the following criteria:

- Ventilating filters without double check valve:  
 $\Delta p < 0.44$  psi
- Ventilating filters with double check valve:  
 $\Delta p < 1.45$  psi for air IN

### Connection

Threaded ports according to American National Standard (ANSI).

Sizes see Selection Chart, column 6 (other port threads on request)

### Filter fineness

2  $\mu$ m

Tested in a single pass test with ISO MTD

### Hydraulic fluids

Mineral oil and biodegradable fluids  
(HEES and HETG, see info sheet 00.20).

### Temperature range hydraulic fluid

- 22 °F ... + 212 °F

### Temperature range environment

- 22 °F ... + 212 °F

### Materials

Cap:	Polyamide, GF reinforced (L1.0506 Polyester, GK reinforced)
Base:	Polyamide, GF reinforced
Dipstick:	Stainless steel (1.4301)
Gaskets:	NBR (FKM on request)
Filter media:	Composite, multi-layer


### Mounting position

No limitation, position on the tank see section Layout


## Diagrams

### $\Delta p$ -curves for complete filters in Selection Chart, column 3


**D1** Pressure drop as a function of the **flow volume**  
**Air IN/OUT**

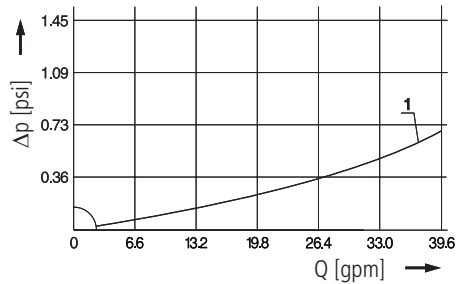


Pressure drop as a function of the **flow volume**  
**Air IN/OUT**

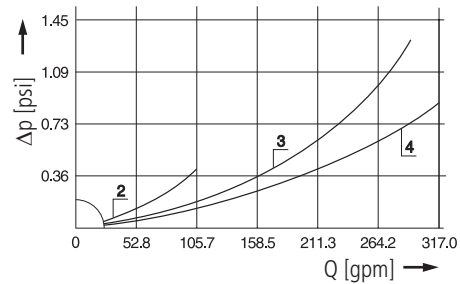


**D2** Pressure drop as a function of the **flow volume**  
**Air IN**

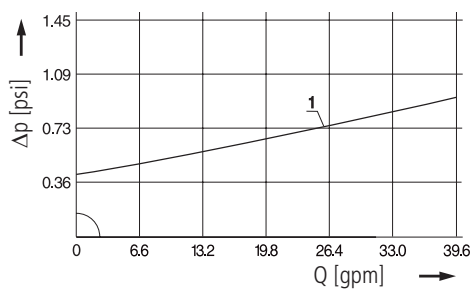


Pressure drop as a function of the **flow volume**  
**Air OUT**

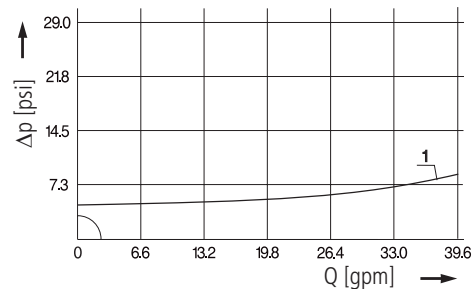

**D3** Pressure drop as a function of the **flow volume**  
**Air IN**

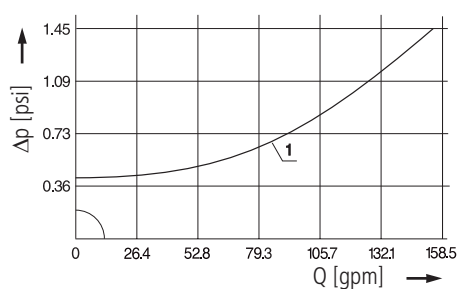


Pressure drop as a function of the **flow volume**  
**Air OUT**

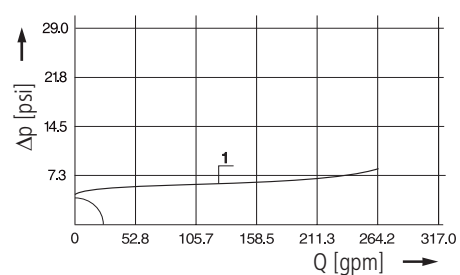

### Filter fineness curves in Selection Chart, column 4

**Dx** Filtration ratio  $\beta$  as a function of particle size  $x$  tested in a single pass test with ISO MTD

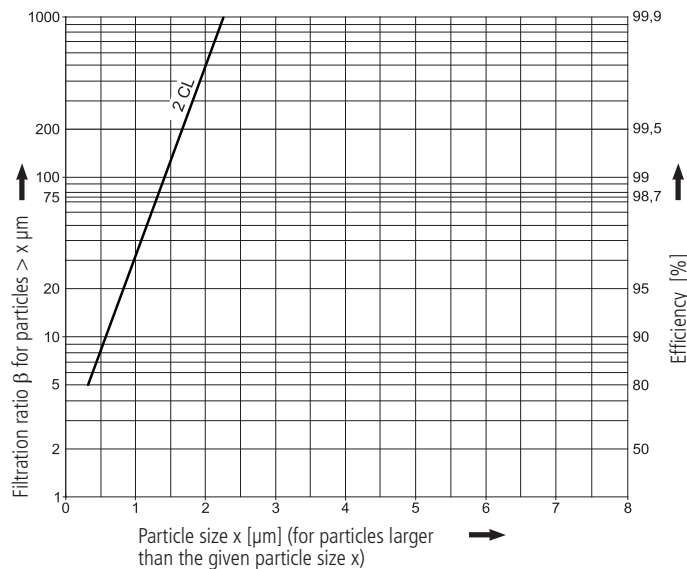

The abbreviations represent the following  $\beta$ -values resp. finenesses:

**2CL** = 2  $\mu$ m Composite  
99.5 % efficiency for particles of size 2  $\mu$ m  
tested in a single pass test with ISO MTD

For special applications, finenesses differing from these curves are also available by using special composed filter media.

## Selection Chart


[illegible]

## Remarks:

- The ventilating filters listed in this chart are standard filters. If modifications are required, e.g., with integrated dipstick, we kindly ask for your request.
- Ventilating filters in Vandalism Proof design see catalog sheet 50.20.

\*  $\Delta p < 1.45$  psi for air IN

## Dimensions

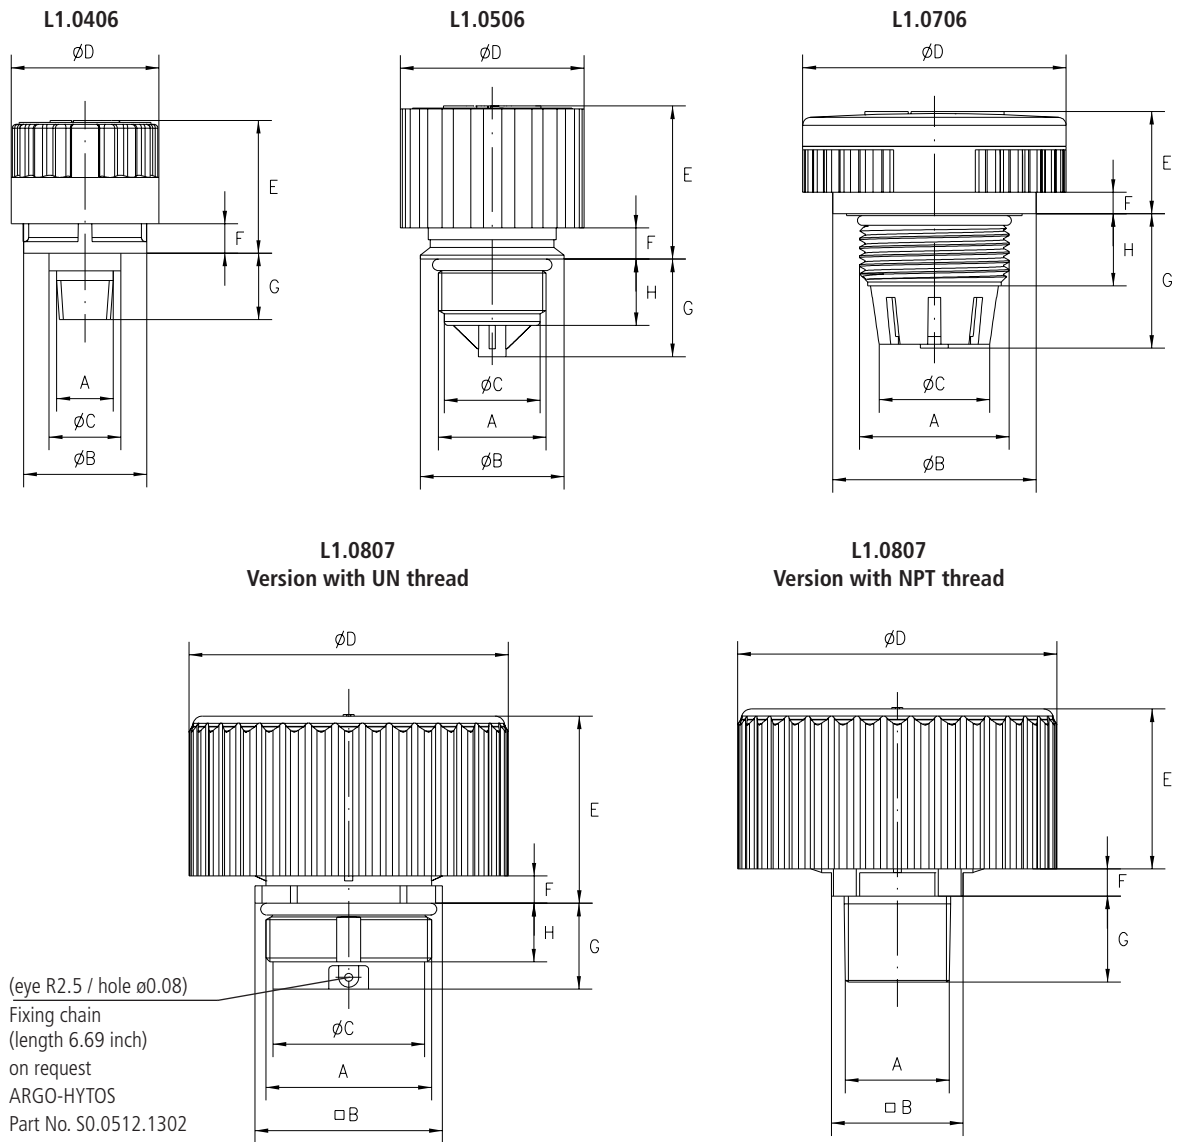


## Measurements

Type	A <sup>1</sup>	B	C	D	E	F	G	H
<b>L1.0406</b>	1/4-18 NPTF <sup>2</sup>	1.24	0.71	1.46	1.52	0.30	0.49	-
<b>L1.0506</b>	1 1/16-12 UN-2A	1.42	0.95	1.81	1.52	0.32	0.98	0.70
<b>L1.0706</b>	1 1/2-UNF-12 2A	2.01	0.81	2.60	1.04	0.24	1.34	0.71
<b>L1.0807</b>	1 3/8-12 UN-2A	47 mm	1.50	3.15	1.97	0.31	0.83	0.55
	3/4-14 NPT <sup>2</sup>	33 mm	as A	3.15	1.97	0.30	0.87	-

<sup>1</sup> The thread dimensions do not exactly conform to the ANSI standard thread (functioning with the ANSI standard thread is guaranteed)

<sup>2</sup> For NPT threads we recommend the use of gasket strip.

## Symbols

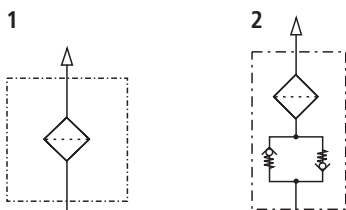

## Layout

### Sizes

The determining factor for selecting the size is the maximum over / under pressure allowed in the container.

For versions without double check valves, the initial pressure drop with a clean air filter should not exceed 0.44 psi.

For versions with double check valves, the initial pressure drop for air IN with a clean air filter should not exceed 1.45 psi.

### Filter fineness

In the ideal case, the fineness of the ventilating filter matches the fineness of the system filter (see also CETOP RP 98 H).

By the use of filter fineness 2 CL the ingress of dust into the tank is effectively reduced.

### Mounting

The ventilating filter should be mounted in a low-dust area of the machine and not in depressions in which water can collect.

For mobile use, the ventilating filter is to be mounted on the tank such that neither splashing oil from the inside nor spray water from the outside can reach the area of the ventilation opening.

### Double check valves

By the use of double check valves, the exchange of air between the tank and the environment can be considerably reduced, whereby the ingress of dust is minimized and the lifetime of the air filter element is increased.

With the double check valve, a predefined level of pressure can be created in the tank in order to improve the suction conditions for the pumps.

The valve opening pressure required for the ventilating filter can be approximately determined with the ideal gas equation depending on the following system characteristics:

- differential volume
- volume of oil in the system
- volume of air in the tank
- operating temperatures

Calculation tool available.

## Quality Assurance

### Quality management according to DIN EN ISO 9001

To ensure constant quality in production and operation, ARGO-HYTOS filter elements undergo strict controls and tests according to the following ISO standards:

<b>ISO 2941</b>	Verification of collapse/burst pressure rating
<b>ISO 2942</b>	Verification of fabrication integrity (Bubble Point Test)
<b>ISO 2943</b>	Verification of material compatibility with fluids

### ISO 3968 ISO 16889

Evaluation of pressure drop versus flow characteristics  
Multi-Pass-Test (evaluation of filter fineness and dirt-holding capacity)

### ISO 23181

Determination of resistance to flow fatigue using high viscosity fluid

Various quality controls during the production process guarantee the leakfree function and solidity of our filters.

Our engineers will be glad to advice you in questions concerning filter application, selection as well as the cleanliness class of the filtered medium attainable under practical operating conditions.

Illustrations may sometimes differ from the original. ARGO-HYTOS is not responsible for any unintentional mistake in this specification sheet.



### We produce fluid power solutions

ARGO-HYTOS Inc. · P.O. Box 28 · Bowling Green, OH 43402 · USA

Phone: +1-419-353-6070 · Fax: +1-419-354-3496 · [info.us@argo-hytos.com](mailto:info.us@argo-hytos.com) · [www.argo-hytos.com](http://www.argo-hytos.com)

Subject to change  
50.10-4us · 0714